


**NOTES:**

1. CONDUIT SHALL BE SCH 40 PVC (SCH 80 UNDER ROADWAYS) UNLESS PRIOR APPROVAL OBTAINED FROM REU
2. METER TO BE SPOTTED ON STRUCTURE BY REU.
3. CONDUIT ABOVE GRADE SHALL BE SCH 80 PVC.
4. METER BASES MUST BE APPROVED FOR USE BY REU.

SERVICE ENTRANCE SIZE (AMPS)	CONDUIT SIZE	WIRE SIZE
100	2"	#2/0
200	2 1/2"	#4/0
400	3"	350 kcmil

TABLE 1

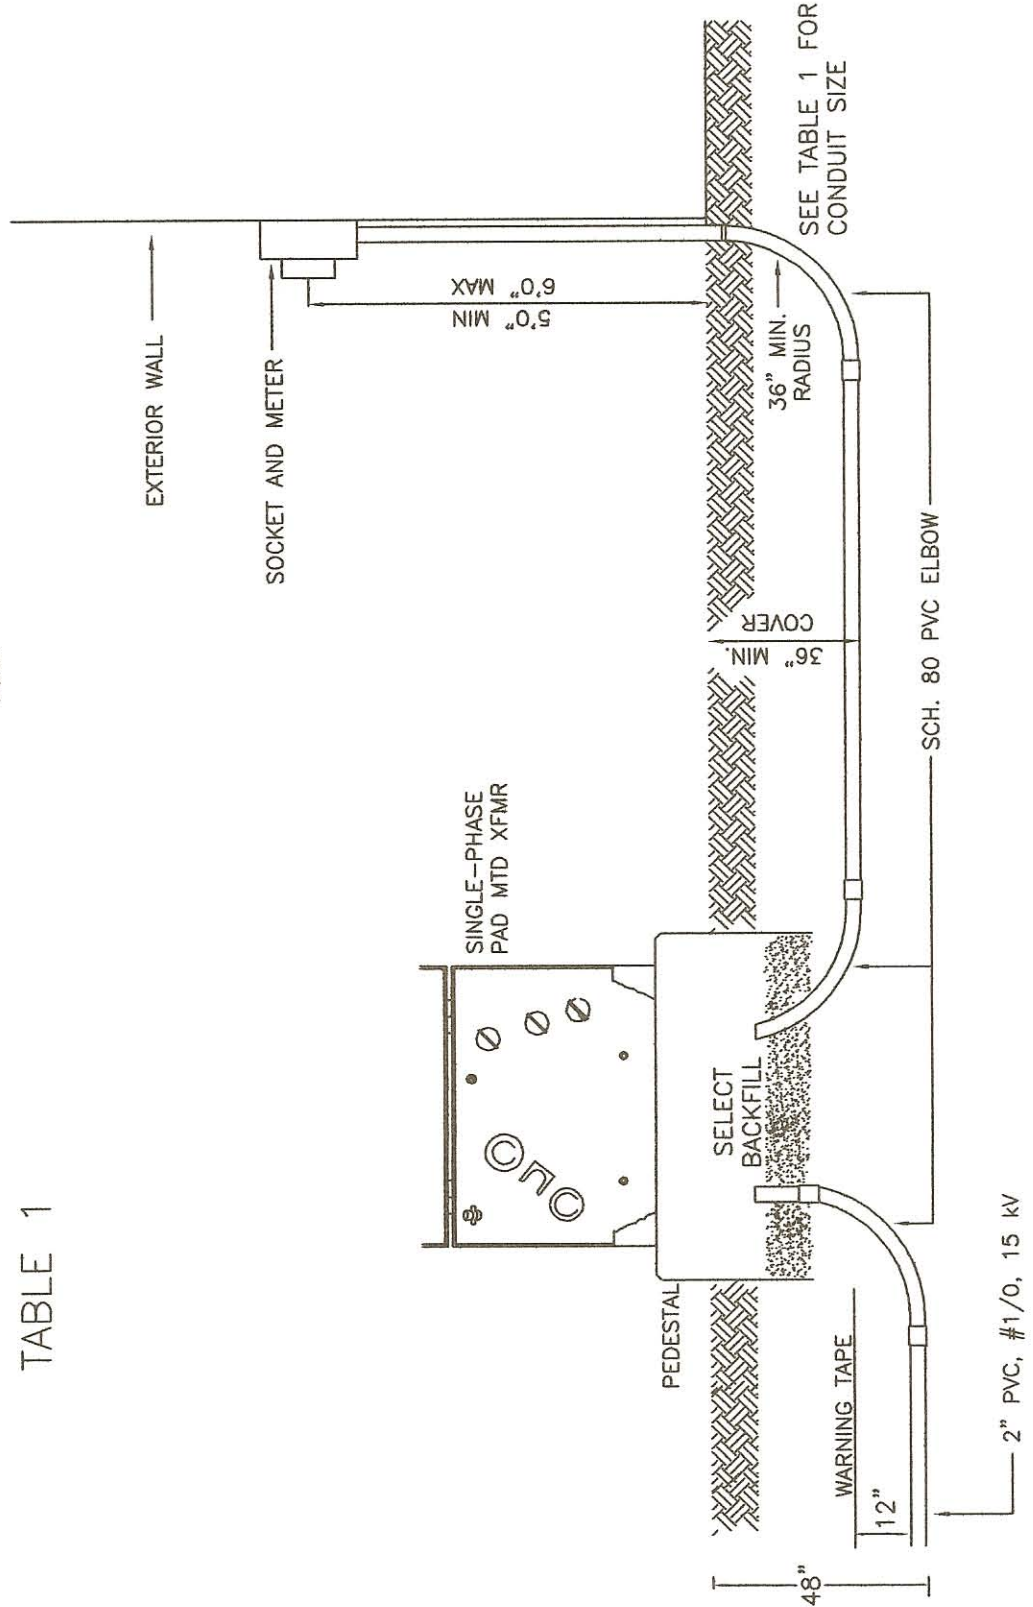

PREPARED BY:	KDB
CHECKED BY:	JD
APPROVED BY:	KDB
ROCKWOOD ELECTRIC UTILITY	
341 W. ROCKWOOD ST. ROCKWOOD, TN 37854	

PAD MOUNTED  
RESIDENTIAL SERVICE  
200 - 400 AMP

SCALE: NONE	
DRAWING NUMBER	REV.
UGS-003	0