



**REU PRIMARY ONLY**

**NOTES:**

1. CLEARANCES ARE SPECIFIED TO ACCOMMODATE FUTURE MAINTENANCE OF UNDERGROUND FACILITIES.
2. SELECTED BACKFILL SHALL BE FREE FROM ROCKS OR OTHER MATERIAL WHICH MIGHT DAMAGE CONDUIT.
3. CLEARANCE REQUIREMENTS OF OTHER UTILITIES SHALL GOVERN IF GREATER THAN SPECIFIED.
4. GAS, WATER, AND SEWER PIPING SHALL BE INSTALLED IN SEPARATE TRENCHES FROM ELECTRICAL.

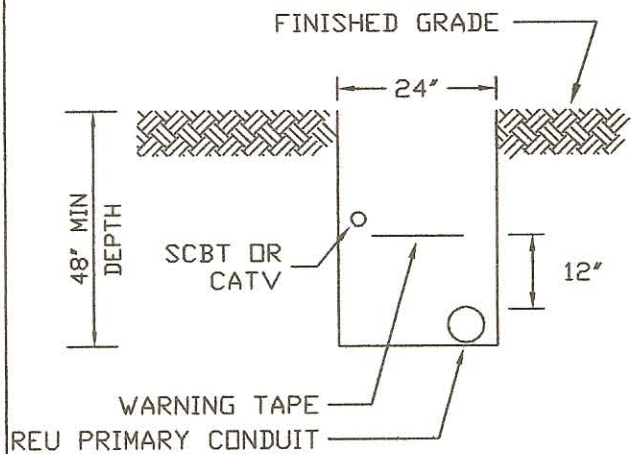

**REU PRIMARY & COMMUNICATIONS**

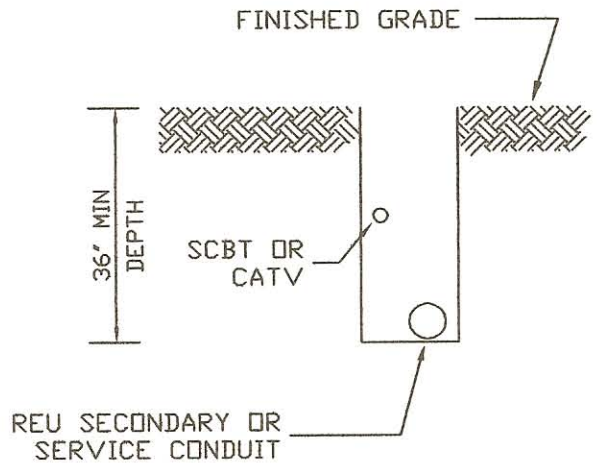

**REU SECONDARY & COMMUNICATIONS**

PREPARED BY:	KDB
CHECKED BY:	JD
APPROVED BY:	KDB

ROCKWOOD ELECTRIC UTILITY  
 341 W. ROCKWOOD ST.  
 ROCKWOOD, TN 37854

TRENCH REQUIREMENTS  
 RESIDENTIAL INSTALLATIONS

SCALE: NONE

DRAWING NUMBER	REV.
UGS-001	0